





JXCK-2M | JXCK-3M

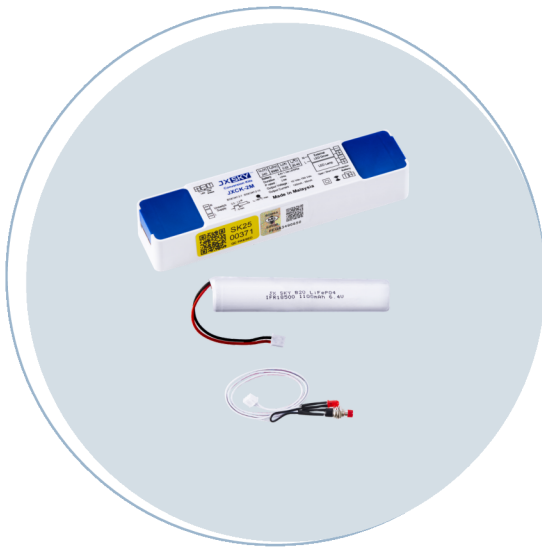


Choose Configuration Type

1 Without External Driver

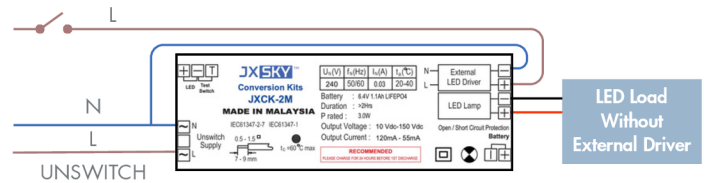


2 With An External Driver

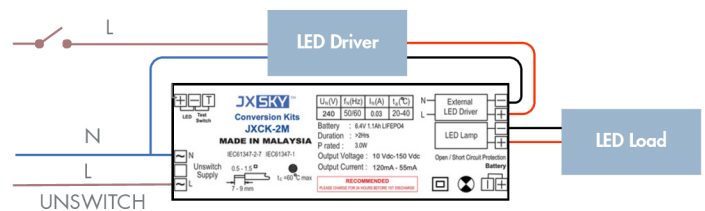


Installation Steps

1




Connect the product to the LED load as shown in the wiring diagrams, ensuring the configuration matches your specific setup.

2



Connect **Neutral** and **Unswitched Live** wires.

3



To **activate** the manual **Emergency Light-up** mode, **press and hold** the **Test Switch** for **3 seconds**. The LED light will turn on to indicate proper operation.

To **turn the light off**, **press and hold** the **Test Switch** again for **3 seconds**.

Charge the battery for a minimum of 24 hours before using the luminaire as a safety/emergency lighting source.

The luminaire must be installed by a qualified electrician. Always disconnect the power supply before performing any wiring work. Ensure that the input voltage matches the specified voltage range of the product. Ensure that all wiring connections are secure and properly insulated. Before turning the power on, double-check that all wires are correctly connected. Failure to follow these instructions may void the product warranty.

Product specifications may change without prior notice. Images are for illustration only.